

New Hope Pump Station

General Site and Safety Considerations

Wednesday, December 02, 2015

GENERAL SITE CONDITION/ACCESS

Vehicle Entrance and Exit to Site	Parking lot and driveway off of Williams Highway
Parking	Diner parking lot
Sight lighting Fixture	None

SAFETY CONSIDERATIONS

General Site Safety Issues	No issues noted
----------------------------	-----------------

SITE SECURITY

Facility Fenced	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
Privacy Fence	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	
Fence Material	Chain link	Height of Fence	8 feet
Method of Securing Access Gates	Padlock	Fence Topping	3-strand barbed wire
Adequate security for keeping public off site?	Yes		

Notes:



General Site Photos

Wednesday, December 02, 2015



Station site, south face of structure



Station site, southeast corner



Station site, west side of structure

Equipment Housing

Wednesday, December 02, 2015

Equipment Housing	<input checked="" type="checkbox"/> Building	<input type="checkbox"/> Enclosure	<input type="checkbox"/> Other		
Condition	<input checked="" type="checkbox"/> 1	<input type="checkbox"/> 2	<input type="checkbox"/> 3	<input type="checkbox"/> 4	<input type="checkbox"/> 5
Criticality	<input type="checkbox"/> 1	<input type="checkbox"/> 2	<input type="checkbox"/> 3	<input checked="" type="checkbox"/> 4	
Serviceability	<input checked="" type="checkbox"/> 1	<input type="checkbox"/> 2	<input type="checkbox"/> 3	<input type="checkbox"/> 4	

Structural Materials	CMU block w/ stick frame roof
Age	Constructed in 2000

Locking Doors	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Intrusion Alarm	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No

Dimensions:

Length	~41	ft
Width	~30	ft

HVAC:

Heat	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Cooling	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
Humidity Control	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No
Fan	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No

Notes:

Not all fans work. Only #3 works. Fans 1 and 2 were inoperable during the visit.



Equipment Housing Photos

Wednesday, December 02, 2015



South face of structure, main entrance



East face of structure



Inside of structure



Inside of structure



North face of structure



West face of structure

Flow Meter and Vault(s)

Wednesday, December 02, 2015

Flow Meter - Domestic	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No			
Condition	<input type="checkbox"/> 1	<input checked="" type="checkbox"/> 2	<input type="checkbox"/> 3	<input type="checkbox"/> 4	<input type="checkbox"/> 5
Criticality	<input checked="" type="checkbox"/> 1	<input type="checkbox"/> 2	<input type="checkbox"/> 3	<input type="checkbox"/> 4	
Serviceability	<input type="checkbox"/> 1	<input type="checkbox"/> 2	<input type="checkbox"/> 3	<input type="checkbox"/> 4	
Asset Nos.	FT-7-3-1				
Location.	Pipe trench in building				
Type/Manufacturer	ABB, 6" MFE4ER140111 and Metron, 4" 19AFT3				
Age	Installed 2000				

Flow Meter - High Capacity	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No			
Condition	<input type="checkbox"/> 1	<input checked="" type="checkbox"/> 2	<input type="checkbox"/> 3	<input type="checkbox"/> 4	<input type="checkbox"/> 5
Criticality	<input checked="" type="checkbox"/> 1	<input type="checkbox"/> 2	<input type="checkbox"/> 3	<input type="checkbox"/> 4	
Serviceability	<input type="checkbox"/> 1	<input type="checkbox"/> 2	<input type="checkbox"/> 3	<input type="checkbox"/> 4	
Asset Nos.	FT-7-3-2				
Location.	Pipe trench in building				
Type/Manufacturer	ABB, 10" MFE4ER140111				
Age	Installed 2000				

Vault	<input type="checkbox"/> Yes	<input type="checkbox"/> No	<input checked="" type="checkbox"/> N/A
Description			
Structural Materials			
Dimensions			
Age			
Access Hatch Fall Protection	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
Access Hatch Lock	<input type="checkbox"/> Yes	<input type="checkbox"/> No	
Intrusion Alarm	<input type="checkbox"/> Yes	<input type="checkbox"/> No	

Notes:



Flow Meter and Vault(s) Photos

Wednesday, December 02, 2015

No meter photos

NEW HOPE #1

Wednesday, December 02, 2015

Suction Zone	1108.5	Discharge Zone	1280
---------------------	--------	-----------------------	------

Pumping System No. 1

Condition 1 2 3 4 5

Criticality 1 2 3 4

Serviceability 1 2 3 4

Pump Type Vert. Turb. End Suction Split case In-line centrifugal

Mounting Horizontal Vertical

Pump from Piping Can Basin/Clearwell

Pump to Closed zone Pressure tank Reservoir

Asset no.	P-7-3-1
Manufacturer	INGERSOL-DRESSER
Model	2.5 LR-10C
Serial #	0899-7060-B
Age	Installed 2000

Rated Design Pt 350 gpm @ 212 feet TDH

Ability to Isolate Pump Yes No

How to Remove Pump Overhead rail

MOTOR

ODP TEFC TENV TEBC Diesel Engine Other

Horsepower 30 Voltage 460 Phase 3 rpm 3560

Manufacturer	US Motors
Model	Unknown
Serial #	C10 98123276-0018
Age	Installed 2000

Inverter duty rated? Yes No Unknown

Motor Driver VFD Soft Starter FVNR Starter None

Notes:



Valves and Gauges

Wednesday, December 02, 2015

Check/Control Valve	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No													
Reported/Exterior Condition	No issues noted.														
Asset Nos.															
Type/Manufacturer	Globe check with pressure relief due to fire pump startup and shutdown.														
Age	Installed 2000														
Isolation Valve(s)	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No													
Reported/Exterior Condition	No issues noted.														
Asset Nos.	FV-7-3-1-1, FV-7-3-1-3														
Type/Manufacturer	GV/AFC - 6" & 4"														
Age	Installed 2000														
Pressure Gauge(s)	<input type="checkbox"/> Yes	<input type="checkbox"/> No													
Asset Nos.	<table border="0"> <tr> <td>PIT-7-3-1</td> <td>Pressure Transmitter</td> <td>Barton/ Fugi</td> <td>FHP/FKP</td> </tr> <tr> <td>PIT-7-3-2</td> <td>Discharge Pressure Transmitter</td> <td>Barton/ Fugi</td> <td>FHP/FKP</td> </tr> <tr> <td>PIT-7-3-5</td> <td>Tank Pressure Transmitter</td> <td>Dwyer</td> <td>0-300psi</td> </tr> </table>			PIT-7-3-1	Pressure Transmitter	Barton/ Fugi	FHP/FKP	PIT-7-3-2	Discharge Pressure Transmitter	Barton/ Fugi	FHP/FKP	PIT-7-3-5	Tank Pressure Transmitter	Dwyer	0-300psi
PIT-7-3-1	Pressure Transmitter	Barton/ Fugi	FHP/FKP												
PIT-7-3-2	Discharge Pressure Transmitter	Barton/ Fugi	FHP/FKP												
PIT-7-3-5	Tank Pressure Transmitter	Dwyer	0-300psi												
Type/Manufacturer															
Age	Installed 2000														

Notes:

FV-7-3-1-4 New Hope Pressure Relief Inlet Isolation Valve AFC 3" 01-Jan-00 Gate Valve
 FV-7-3-1-6 New Hope Pressure Relief Outlet Isolation Valve AFC 3" 01-Jan-00 Gate Valve

PRV-7-3-1-5 New Hope #1 Booster Pump Pressure Relief Control Valve OCV Control Valves 3" 108-2



Piping

Wednesday, December 02, 2015

Common Suction Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	16", 8"
Pipe material	Ductile iron
Age	Installed 2000

Pump Specific Suction Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	6"
Pipe material	Ductile iron
Age	Installed 2000

Pump Specific Discharge Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	4"
Pipe material	Ductile iron
Age	Installed 2000

Common Discharge Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	8", 16"
Pipe material	Ductile iron
Age	Installed 2000

Notes:



Pump/Valve/Piping Photos


Wednesday, December 02, 2015



Pumping System No. 1




Pumping System No. 1 motor nameplate

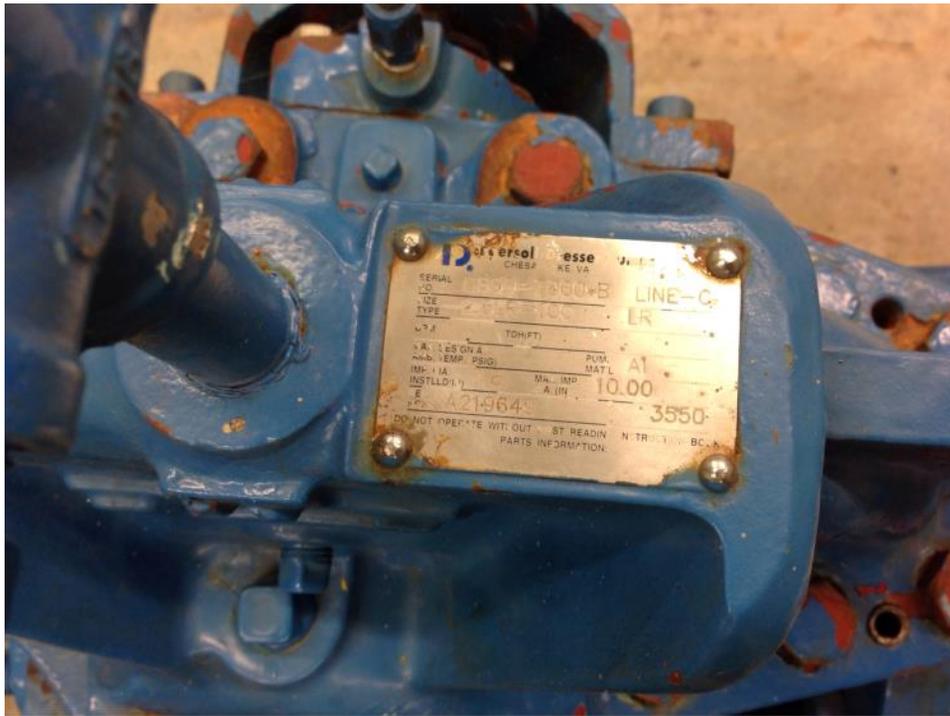

Pumping System No. 1 pump nameplate



Pumping System No. 1 discharge piping and common pressure relief

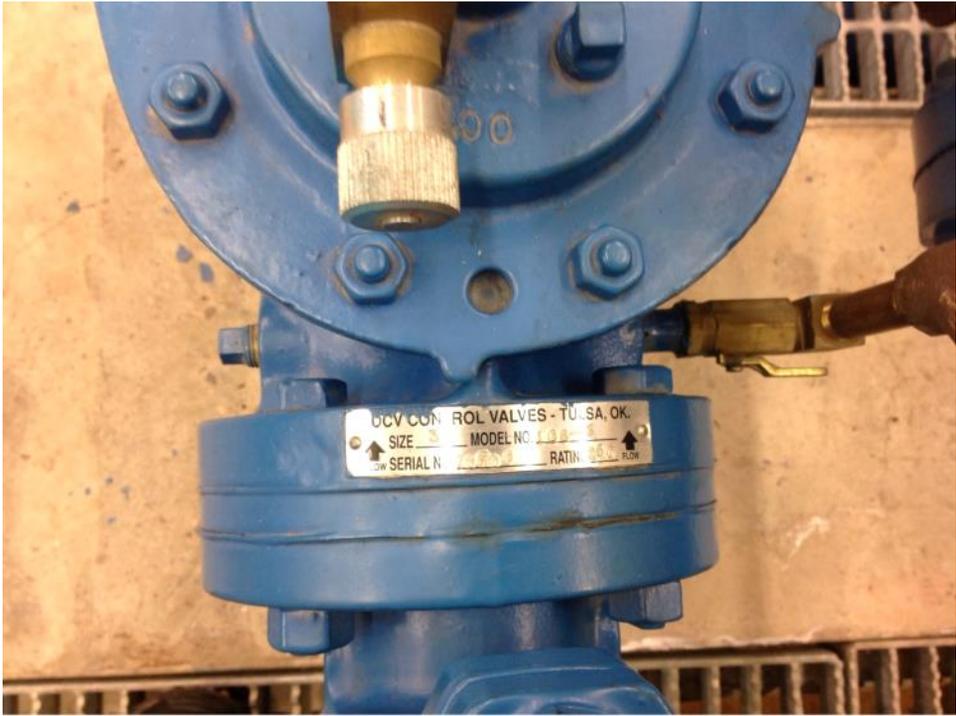

Common pressure relief valve nameplate



Pumping system layout view

NEW HOPE #2

Wednesday, December 02, 2015

Suction Zone	1108.5	Discharge Zone	1280
---------------------	--------	-----------------------	------

Pumping System No. 2

Condition 1 2 3 4 5

Criticality 1 2 3 4

Serviceability 1 2 3 4

Pump Type Vert. Turb. End Suction Split case In-line centrifugal

Mounting Horizontal Vertical

Pump from Piping Can Basin/Clearwell

Pump to Closed zone Pressure tank Reservoir

Asset no.	P-7-3-2
Manufacturer	INGERSOL-DRESSER
Model	2.5 LR-10C
Serial #	0899-7060-A
Age	Installed 2000

Rated Design Pt 350 gpm @ 212 feet TDH

Ability to Isolate Pump Yes No

How to Remove Pump Overhead rail

MOTOR

ODP TEFC TENV TEBC Diesel Engine Other

Horsepower 30 Voltage 460 Phase 3 rpm 3560

Manufacturer	US Motors
Model	Unknown
Serial #	Unknown
Age	Installed 2000

Inverter duty rated? Yes No Unknown

Motor Driver VFD Soft Starter FVNR Starter None

Notes:



Valves and Gauges

Wednesday, December 02, 2015

Check/Control Valve	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Reported/Exterior Condition	No issues noted.	
Asset Nos.		
Type/Manufacturer	Globe check with pressure relief due to fire pump startup and shutdown.	
Age	Installed 2000	

Isolation Valve(s)	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Reported/Exterior Condition	No issues noted.	
Asset Nos.	FV-7-3-2-1, FV-7-3-2-3	
Type/Manufacturer	GV/AFC - 6" & 4"	
Age	Installed 2000	

Pressure Gauge(s)	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Asset Nos.	See pumping system no. 1 for information	
Type/Manufacturer		
Age		

Notes:



Piping

Wednesday, December 02, 2015

Common Suction Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	16", 8"
Pipe material	Ductile iron
Age	Installed 2000

Pump Specific Suction Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	6"
Pipe material	Ductile iron
Age	Installed 2000

Pump Specific Discharge Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	4"
Pipe material	Ductile iron
Age	Installed 2000

Common Discharge Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	8", 16"
Pipe material	Ductile iron
Age	Installed 2000

Notes:



Pump/Valve/Piping Photos

Wednesday, December 02, 2015



Pumping System No. 2



Pumping System No. 2 motor nameplate



Pumping System No. 2 pump nameplate



Pumping System No. 2 discharge piping

NEW HOPE #3

Wednesday, December 02, 2015

Suction Zone	1108.5	Discharge Zone	1280
---------------------	--------	-----------------------	------

Pumping System No. 3

Condition 1 2 3 4 5

Criticality 1 2 3 4

Serviceability 1 2 3 4

Pump Type Vert. Turb. End Suction Split case In-line centrifugal

Mounting Horizontal Vertical

Pump from Piping Can Basin/Clearwell

Pump to Closed zone Pressure tank Reservoir

Asset no.	P-7-3-3
Manufacturer	Ingersol -Dresser
Model	2.5 LR-10C
Serial #	0899-7060-C
Age	Installed 2000

Rated Design Pt 350 gpm @ 212 feet TDH

Ability to Isolate Pump Yes No

How to Remove Pump Overhead rail

MOTOR

ODP TEFC TENV TEBC Diesel Engine Other

Horsepower 30 Voltage 460 Phase 3 rpm 3560

Manufacturer	US Motors
Model	Unknown
Serial #	Unknown
Age	Installed 2000

Inverter duty rated? Yes No Unknown

Motor Driver VFD Soft Starter FVNR Starter None

Notes:



Valves and Gauges

Wednesday, December 02, 2015

Check/Control Valve	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
----------------------------	---	-----------------------------

Reported/Exterior Condition	No issues noted.
Asset Nos.	
Type/Manufacturer	Globe check with pressure relief due to fire pump startup and shutdown.
Age	Installed 2000

Isolation Valve(s)	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
---------------------------	---	-----------------------------

Reported/Exterior Condition	No issues noted.
Asset Nos.	FV-7-3-3-1, FV-7-3-3-3
Type/Manufacturer	GV/AFC - 6" & 4"
Age	Installed 2000

Pressure Gauge(s)	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
--------------------------	---	-----------------------------

Asset Nos.	See pumping system no. 1 for information
Type/Manufacturer	
Age	

Notes:

FV-7-3-3-4	New Hope Station PRV Discharge Isolation Valve	AFC	4"	01-Jan-00	Gate Valve
FV-7-3-3-6	New Hope Station Pressure Tank Isolation Valve	AFC	4"	01-Jan-00	Gate Valve
PRV-7-3-3-5	New Hope Pump Station Pressure Reducing Control Valve	OCV Control Valves	3" 108-2		



Piping

Wednesday, December 02, 2015

Common Suction Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	16", 8"
Pipe material	Ductile iron
Age	Installed 2000

Pump Specific Suction Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	6"
Pipe material	Ductile iron
Age	Installed 2000

Pump Specific Discharge Pipe


Reported/Exterior Condition	No issues noted.
Pipe size	4"
Pipe material	Ductile iron
Age	Installed 2000

Common Discharge Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	8", 16"
Pipe material	Ductile iron
Age	Installed 2000

Notes:



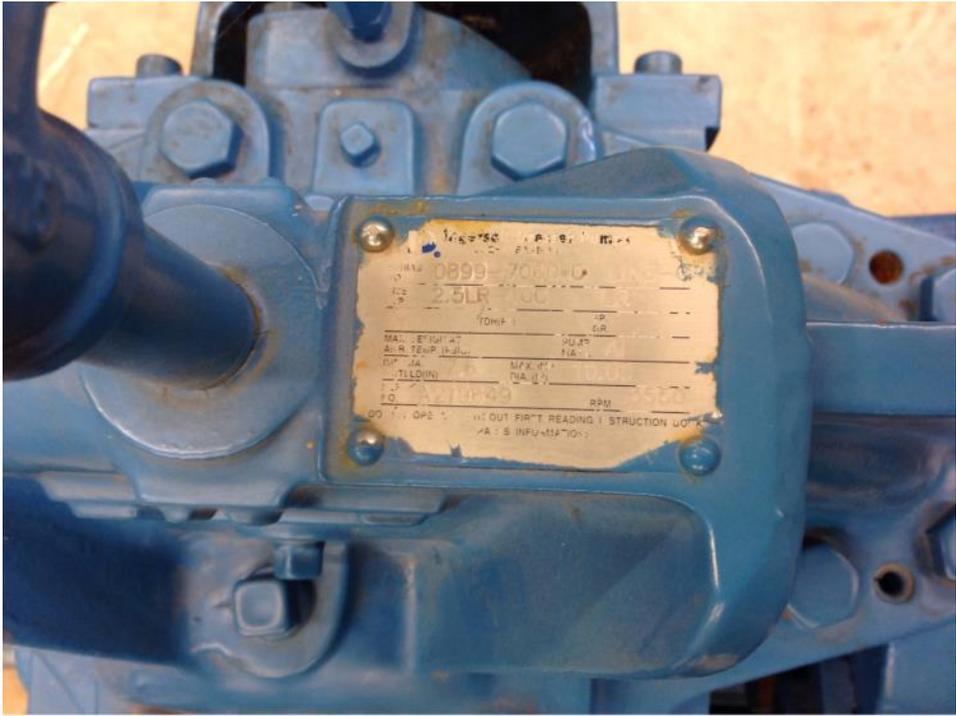

Pumping System No. 3 pump nameplate



Pumping System No. 3 discharge piping

NEW HOPE #4

Wednesday, December 02, 2015

Suction Zone	1108.5	Discharge Zone	1280
---------------------	--------	-----------------------	------

Pumping System No. 4

Condition 1 2 3 4 5

Criticality 1 2 3 4

Serviceability 1 2 3 4

Pump Type Vert. Turb. End Suction Split case In-line centrifugal

Mounting Horizontal Vertical

Pump from Piping Can Basin/Clearwell

Pump to Closed zone Pressure tank Reservoir

Asset no.	P-7-3-4
Manufacturer	INGERSOL-DRESSER
Model	6LR-18A
Serial #	0899-7061
Age	Installed 2000

Rated Design Pt 2000 gpm @ 200 feet TDH

Ability to Isolate Pump Yes No

How to Remove Pump Overhead rail

MOTOR

ODP TEFC TENV TEBC Diesel Engine Other

Horsepower 150 Voltage 460 Phase 3 rpm 1780

Manufacturer	US Motors
Model	Unknown
Serial #	Unknown
Age	Installed 2000

Inverter duty rated? Yes No Unknown

Motor Driver VFD Soft Starter FVNR Starter None

Notes:



Valves and Gauges

Wednesday, December 02, 2015

Check/Control Valve	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Reported/Exterior Condition	No issues noted.	
Asset Nos.	FCV-7-3-4-2	
Type/Manufacturer	OCV, 10" 125-27	
Age	Installed 2000	

Isolation Valve(s)	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Reported/Exterior Condition	No issues noted.	
Asset Nos.	FV-7-3-4-1, FV-7-3-4-3, FV-7-3-4-5, FV-7-3-4-6	
Type/Manufacturer	BV/ Keystone - 12" & 10" GV/AFC - 6" & 6"	
Age	Installed 2000	

Pressure Gauge(s)	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Asset Nos.	See pumping system no. 1 for information	
Type/Manufacturer		
Age		

Notes:

PRV-7-3-4-4 New Hope #4 Booster Pump Pressure Relief Control Valve OCV Control Valves 6 "108-2



Piping

Wednesday, December 02, 2015

Common Suction Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	16", 8"
Pipe material	Ductile iron
Age	Installed 2000

Pump Specific Suction Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	12"
Pipe material	Ductile iron
Age	Installed 2000

Pump Specific Discharge Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	12"
Pipe material	Ductile iron
Age	Installed 2000

Common Discharge Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	16"
Pipe material	Ductile iron
Age	Installed 2000

Notes:





Pumping System No. 4 pump nameplate



Pumping System No. 4 pump control valve



Pumping System No. 4 pump control valve and control/check valve on domestic demand line



Domestic demand line control/check valve nameplate

NEW HOPE #5A

Wednesday, December 02, 2015

Suction Zone	1108.5	Discharge Zone	1280
---------------------	--------	-----------------------	------

Pumping System No. 5A

Condition 1 2 3 4 5

Criticality 1 2 3 4

Serviceability 1 2 3 4

Pump Type Vert. Turb. End Suction Split case In-line centrifugal

Mounting Horizontal Vertical

Pump from Piping Can Basin/Clearwell

Pump to Closed zone Pressure tank Reservoir

Asset no.	P-7-3-5A
Manufacturer	Grundfos
Model	100BC-2-182TC-C2
Serial #	A-96523174 P10702647
Age	Installed 2007

Rated Design Pt 53 gpm @ 227 feet TDH

Ability to Isolate Pump Yes No

How to Remove Pump Overhead rail

MOTOR

ODP TEFC TENV TEBC Diesel Engine Other

Horsepower 5 Voltage Phase rpm

Manufacturer	Unknown
Model	Unknown
Serial #	Unknown
Age	Installed 2007

Inverter duty rated? Yes No Unknown

Motor Driver VFD Soft Starter FVNR Starter None

Notes:



Valves and Gauges

Wednesday, December 02, 2015

Check/Control Valve	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Reported/Exterior Condition	No issues noted.	
Asset Nos.		
Type/Manufacturer	Wafer check	
Age	Installed 2000	

Isolation Valve(s)	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Reported/Exterior Condition	No issues noted.	
Asset Nos.	FV-7-3-5A-1, FV-7-3-5A-3	
Type/Manufacturer	GV/Kennedy - 2" & 2"	
Age	Installed 2000	

Pressure Gauge(s)	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Asset Nos.		
Type/Manufacturer	Unknown - pressure off of tank	
Age	Unknown	

Notes:



Piping

Wednesday, December 02, 2015

Common Suction Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	4"
Pipe material	Ductile iron
Age	Installed 2000

Pump Specific Suction Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	4"
Pipe material	Ductile iron
Age	Installed 2000

Pump Specific Discharge Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	4"
Pipe material	Ductile iron
Age	Installed 2000

Common Discharge Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	4"
Pipe material	Ductile iron
Age	Installed 2000

Notes:




Pump/Valve/Piping Photos


Wednesday, December 02, 2015



Pumping Systems 5A and 5B

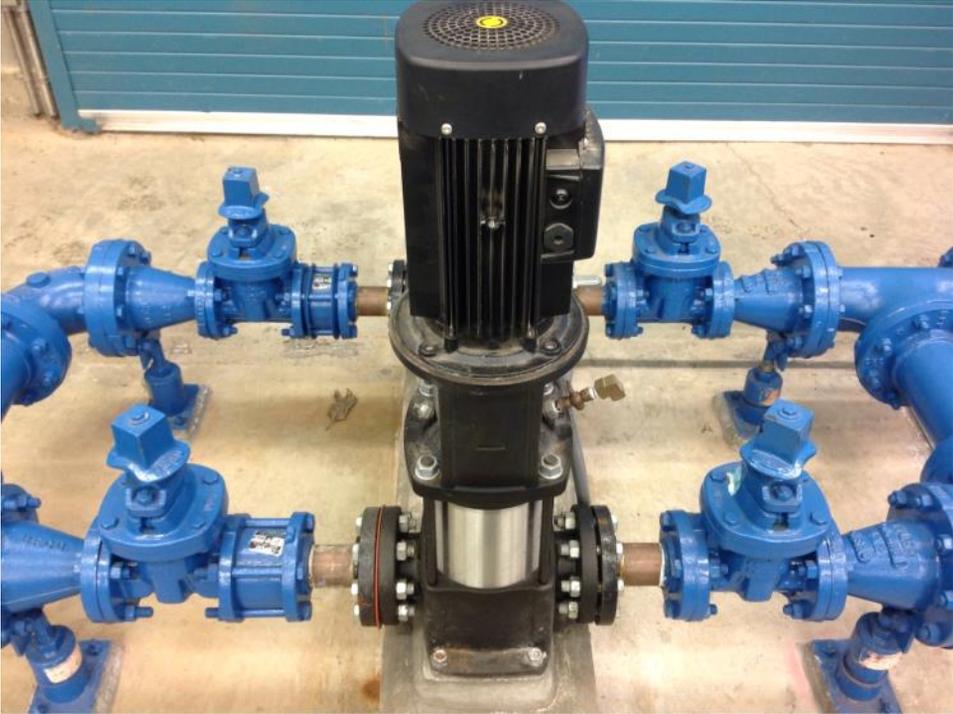

Pumping System 5A

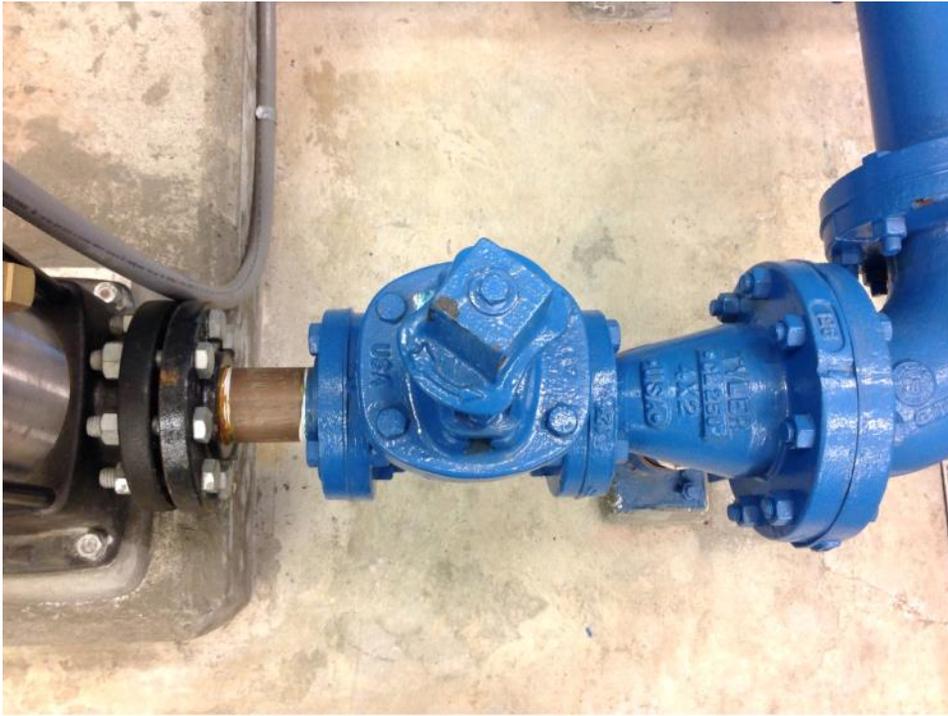


Pumping System 5A suction isolation valve



Pumping System 5A discharge isolation valve



Pumping Systems 5A and 5B discharge piping to pressure tank

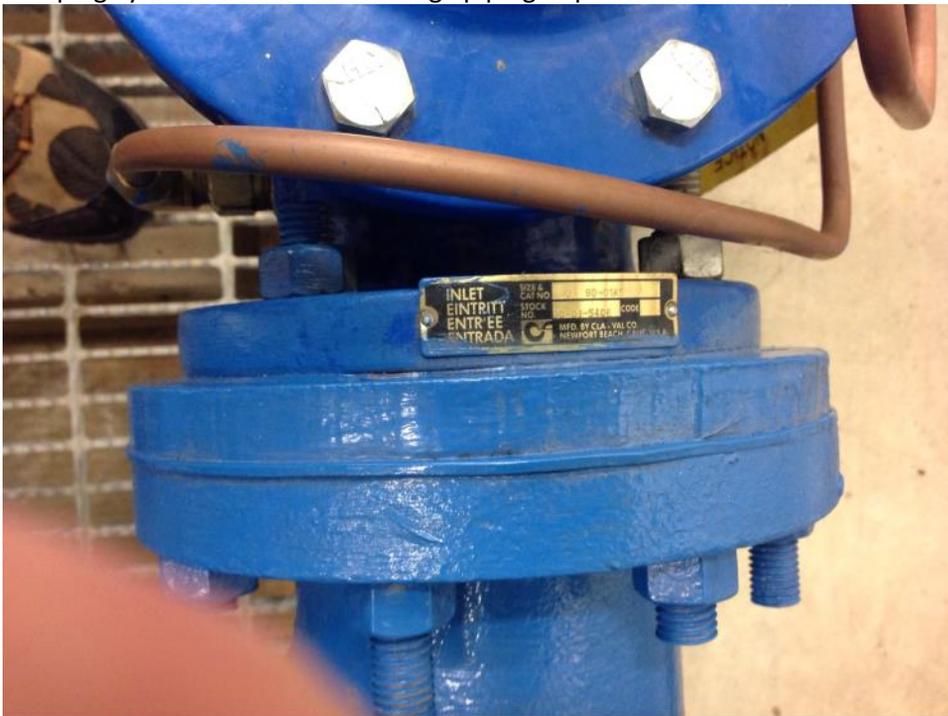

Pumping Systems 5A and 5B pressure reducing valve to system

NEW HOPE #5B

Wednesday, December 02, 2015

Suction Zone	1108.5	Discharge Zone	1280
---------------------	--------	-----------------------	------

Pumping System No. 5B

Condition 1 2 3 4 5

Criticality 1 2 3 4

Serviceability 1 2 3 4

Pump Type Vert. Turb. End Suction Split case In-line centrifugal

Mounting Horizontal Vertical

Pump from Piping Can Basin/Clearwell

Pump to Closed zone Pressure tank Reservoir

Asset no.	P-7-3-5B
Manufacturer	Grundfos
Model	100BC-2-182TC-C2
Serial #	85900713
Age	Installed 2007

Rated Design Pt 53 gpm @ 227 feet TDH

Ability to Isolate Pump Yes No

How to Remove Pump Overhead rail

MOTOR

ODP TEFC TENV TEBC Diesel Engine Other

Horsepower 5 Voltage Phase rpm

Manufacturer	Unknown
Model	Unknown
Serial #	Unknown
Age	Installed 2000

Inverter duty rated? Yes No Unknown

Motor Driver VFD Soft Starter FVNR Starter None

Notes:



Valves and Gauges

Wednesday, December 02, 2015

Check/Control Valve	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Reported/Exterior Condition	No issues noted.	
Asset Nos.		
Type/Manufacturer	Wafer check	
Age	Installed 2000	

Isolation Valve(s)	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Reported/Exterior Condition	No issues noted.	
Asset Nos.	FV-7-3-5B-1, FV-7-3-5B-3	
Type/Manufacturer	GV/Kennedy - 2" & 2"	
Age	Installed 2000	

Pressure Gauge(s)	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No
Asset Nos.		
Type/Manufacturer	Unknown - pressure off of tank	
Age	Unknown	

Notes:



Piping

Wednesday, December 02, 2015

Common Suction Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	4"
Pipe material	Ductile iron
Age	Installed 2000

Pump Specific Suction Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	4"
Pipe material	Ductile iron
Age	Installed 2000

Pump Specific Discharge Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	4"
Pipe material	Ductile iron
Age	Installed 2000

Common Discharge Pipe

Reported/Exterior Condition	No issues noted.
Pipe size	4"
Pipe material	Ductile iron
Age	Installed 2000

Notes:



Pump/Valve/Piping Photos

Wednesday, December 02, 2015



Pumping Systems 5A and 5B



Pumping System 5B

Backup Power

Wednesday, December 02, 2015

BACKUP POWER

Source	<input type="checkbox"/> None	<input type="checkbox"/> Pig tail for portable	<input checked="" type="checkbox"/> On-site, permanent
Transfer Switch	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	
Type	<input type="checkbox"/> Manual	<input checked="" type="checkbox"/> Auto	

Notes:

STANDBY GENERATOR

Condition	<input type="checkbox"/> 1	<input checked="" type="checkbox"/> 2	<input type="checkbox"/> 3	<input type="checkbox"/> 4	<input type="checkbox"/> 5
Criticality	<input type="checkbox"/> 1	<input type="checkbox"/> 2	<input checked="" type="checkbox"/> 3	<input type="checkbox"/> 4	
Serviceability	<input type="checkbox"/> 1	<input type="checkbox"/> 2	<input type="checkbox"/> 3	<input type="checkbox"/> 4	
Asset No.					
Manufacturer	Katolight				
Model	D250FRV4				
Serial #	WA522135 61005				
Age(s)	Installed 2000				
Electrical capacity	KW	250	Voltage	480	Phase(s) 3
Fuel type	<input checked="" type="checkbox"/> Diesel	<input type="checkbox"/> Nat. Gas	<input type="checkbox"/> Propane	<input type="checkbox"/> Gasoline	<input type="checkbox"/> Other
Full load fuel demand		gal/hr			
Fuel stored on-site	550	gal			

Notes:



Backup Power Photos

Wednesday, December 02, 2015



Backup power generator



Backup power generator nameplate